
CUBE2-HEX PENDANT CABLE INSTALLATION INSTRUCTIONS

BEFORE YOU BEGIN Read and follow all safety instructions



Prepare Electrical Wiring

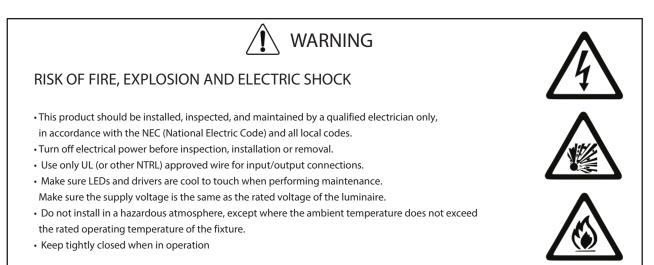

Electrical Requirements

Must check if the local voltage range is correspond with the working voltage of the fixture. Use min. 75°C supply.



Grounding Instructions

The grounding and bonding of the overall system shall be done in accordance with NEC Article 600 and local codes.



Follow all applicable safety procedures and use Personal Protective Equipment such as hardhats, safety glasses, reflective vest, electrical safety gloves, fall protection equipment and safety toe boots during the installation, operation, and maintenance of the luminare.



310-327-7711 utopialightingus.com info@utopialightingus.com

Contractor is responsible for adequately reinforcing ceilings to support luminaire weight. Utopia Lighting accepts no responsibility for inadequately reinforced ceilings. The information contained in this drawing is the sole property of Utopia Lighting Any reproduction in part or whole is prohibited and warranty is voided.



RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY IN ACCORDANCE WITH NATIONAL, LOCAL BUILDING AND ELECTRICAL CODES, DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.


CUBE2-HEX PENDANT CABLE INSTALLATION INSTRUCTIONS

W

Dimensions

Specifications: CUBE2-HEX Width: 2.5 (64) D Depth: 4 (101) All dimensions are in inches (millimeters). 24 (608.4) 48 (1216.8) - 4 mounting points



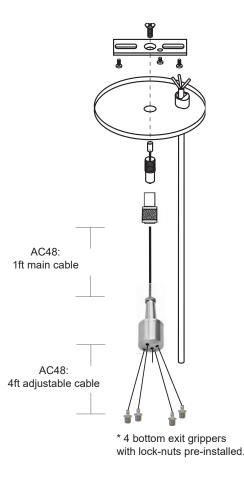



310-327-7711 utopialightingus.com info@utopialightingus.com


Contractor is responsible for adequately reinforcing ceilings to support luminaire weight. Utopia Lighting accepts no responsibility for inadequately reinforced ceilings. The information contained in this drawing is the sole property of Utopia Lighting. Any reproduction in part or whole is prohibited and warranty voided.




RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY IN ACCORDANCE WITH NATIONAL, LOCAL BUILDING AND ELECTRICAL CODES, DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.

CUBE2-HEX PENDANT CABLE INSTALLATION INSTRUCTIONS






Look for the (4) pre-installed grippers on top of the fixture.

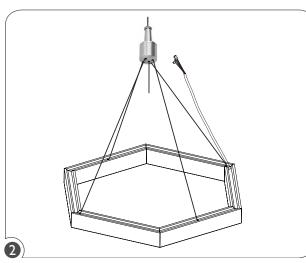

Twist top of the pre-installed gripper to loosen the entrance, insert cables, and lock grippers. Adjust to the desired suspension length.

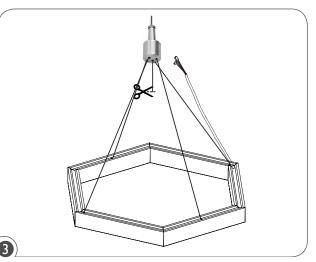

Cut the extra cable in the center once finish adjusting the suspension length.



310-327-7711 utopialightingus.com info@utopialightingus.com

Contractor is responsible for adequately reinforcing ceilings to support luminaire weight. Utopia Lighting accepts no responsibility for inadequately reinforced ceilings. The information contained in this drawing is the sole property of Utopia Lighting. Any reproduction in part or whole is prohibited and warranty voided.



RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY IN ACCORDANCE WITH NATIONAL, LOCAL BUILDING AND ELECTRICAL CODES, DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.